

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. Contract Number	Page of Pages 1 7	
2. Amendment/Modification Number DCAM-2007-B-0072-0001	3. Effective Date 30-Apr-07	4. Requisition/Purchase Request No.		5. Solicitation Caption Replace Lighting System @ 4D	
6. Issued By: Office of Contracting and Procurement Transportation and Specialty Equipment Commodity Group 2000 - 14th Street, NW, 6th Floor Washington, DC 20009		Code KTO	7. Administered By (If other than line 6) Office of Property Management Office of Contract Support/FOMA 2000 - 14th Street, NW, 4th Floor Washington, DC 20009		
8. Name and Address of Contractor (No. Street, city, country, state and ZIP Code)			x	9A. Amendment of Solicitation No. DCAM-2007-B-0072	
				9B. Dated (See Item 11) 28-Mar-07	
				10A. Modification of Contract/Order No.	
				10B. Dated (See Item 13)	
Code	Facility				
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS					
<input checked="" type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers <input checked="" type="checkbox"/> is extended. <input type="checkbox"/> is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter which includes a reference to the solicitation and amendment number. FAILURE OF YOUR ACKNOWLEDGEMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by letter, provided each letter makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.					
12. Accounting and Appropriation Data (If Required)					
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS. IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14.					
A. This change order is issued pursuant to: 27 DCMR 1517					
The changes set forth in Item 14 are made in the contract/order no. in item 10A.					
B. The above numbered contract/order is modified to reflect the administrative changes (such as changes in paying office, appropriation date, etc.) set forth in item 14, pursuant to the authority of 27 DCMR, Chapter 36, Section 3601.2.					
C. This supplemental agreement is entered into pursuant to authority of:					
D. Other (Specify type of modification and authority) 27 DCMR, Section 2008 27 DCMR, Chapter 36 Section 3601(c)					
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input checked="" type="checkbox"/> is required to sign this document and return <u>1</u> copies to the issuing office.					
14. Description of amendment/modification.					
This Addendum No. 1 is being issued for the following:					
1. The Bid Opening Date has been postponed until Tuesday, May 8, 2007 at 2:00 p.m.					
2. Attachment No. 1: Response to questions raised by potential bidders and their answers.					
3. Attachment No. 2: The structural drawings are attached as part of this specification.					
4. Attachment J-1, Specifications, page 2, delete the requirement for paragraph #12.					
Except as provided herein, all terms and conditions of the document referenced in Item (9A or 10A) remain unchanged and in full force and effect.					
15A. Name and Title of Contractor (Type or print)			16A. Name of Contracting Officer (Type or Print)		
			James Roberts		
15B. Signature of Contractor		15C. Date Signed	16B. District of Columbia		16C. Date Signed
(Signature of Person Authorized to Sign)			(Signature of Contracting Officer)		4/30/2007

ATTACHMENT NO. 1

The following responses are answers to questions raised by potential bidders during the past several weeks. These responses are to be considered as additions/clarifications to the bid document package for the Replacement of the Lighting Alert System for the Antenna Tower at the 4th District Police Headquarters.

1. What is the tower manufacturer name? (The top working platform from the original manufacturer may be needed.)

Answer: The tower manufacturer name is Hughes Tower

2. What is the year of the installation?

Answer: The year of the installation is 1993.

3. What is the exact height of the tower?

Answer: See attached drawing for exact height of the tower.

4. How many lighting tiers do you need to have on the tower?

Answer: Three (3) lighting tiers with one beacon on top of monopole are needed on the tower.

5. At what levels do we currently have the existing lighting on the tower?

Answer: We currently have 200 feet; 460 feet and 700 feet beacon on top of monopole at 725 feet.

6. At what exact mounting levels (above ground level) do we need the proposed lighting on the tower?

Answer: Mount the lights at their current elevations, except as otherwise indicated.

7. Will the new lighting be mounted at the present tier locations as we currently have with the exception of the topmost tier which is required by Specification J-1, paragraph 15, to be mounted 10 feet from the top?

Answer: Yes.

8. What are the exact power requirements for the lighting? Is it the standard 120 volt AC only or is there a plan to run from DC (battery bank), that is 120 volt AC and 24 volt DC or 120 volt AC and 48 volt DC.?

Answer: The power requirement of this project will be governed by the latest advanced strobe light technology equipment requirements.

9. Please help us to understand this info better – Specification J-1, paragraph 11 states:

“The contractor shall replace the two (2) existing EG&G high intensity strobe and TWR red incandescent lighting systems with a flash technology 225 dual lighting system which shall include the appropriate number of FTB 225 flash-heads with red strobe beacons, FTB302D AOL beacon, market lights and FTC 121W controller.”

What is/are the appropriate number of the FTB225 high intensity beacons and the corresponding flash heads at each tier? Is it one, two or three numbers at each tier level?

Answer: This shall depend on the number of dual lights in one flash head.

10. Specification J-1, paragraph 15 states:

“The contractor shall provide three (3) hard copies of each deliverable and one electronic version.”

What deliverables are you referring to here?

Answer: Please see the attached specifications.

Date:	Description:
1/20/03	DRAFT FOR REVIEW
1/23/03	FOR ZONING PERMIT
1/30/03	FOR ZONING PERMIT (FINAL)
2/06/03	FOR ZONING PERMIT (REVISED)




PUBLIC SAFETY COMMUNICATIONS PROJECT

ZONING DOCUMENTS
4D / HUGHES TOWER
6001 GEORGIA AVENUE, NW
WASHINGTON, D.C. 20011

PUBLIC SAFETY COMMUNICATIONS PROJECT
4D / HUGHES TOWER
6001 GEORGIA AVENUE, NW
WASHINGTON, DC 20011



Key Plan:



Scales:

Drawing Title:
4D / HUGHES TOWER

ZONING DOCUMENTS
COVER SHEET

Date: 01/23/03
Designed By: NK
Drawn By: IA
Checked By: RS
Drawing No.:
1 of 4

CODE SUMMARY

ZONING CLASSIFICATION: C-2-A

VICINITY PLAN



LOCATION PLAN



INDEX OF DRAWINGS


- 1 of 4 COVER SHEET
- 2 of 4 SITE PLAN
- 3 of 4 ELEVATION
- 4 of 4 TOPOGRAPHICAL SURVEY

Date:	Description:
1/20/03	DRAFT FOR REVIEW
1/23/03	FOR ZONING PERMIT
1/30/03	FOR ZONING PERMIT (FINAL)
2/06/03	FOR ZONING PERMIT (REVISED)

PUBLIC SAFETY COMMUNICATIONS PROJECT
4D / HUGHES TOWER
6001 GEORGIA AVENUE, NW
WASHINGTON, DC 20011



Key Plan:



Scales:


Drawing Title:
4D / HUGHES TOWER

ZONING DOCUMENTS
SITE PLAN

Date: 01/23/03

Designed By: RS
Drawn By: DBS
Checked By: NK

Drawing No.:
2 of 4

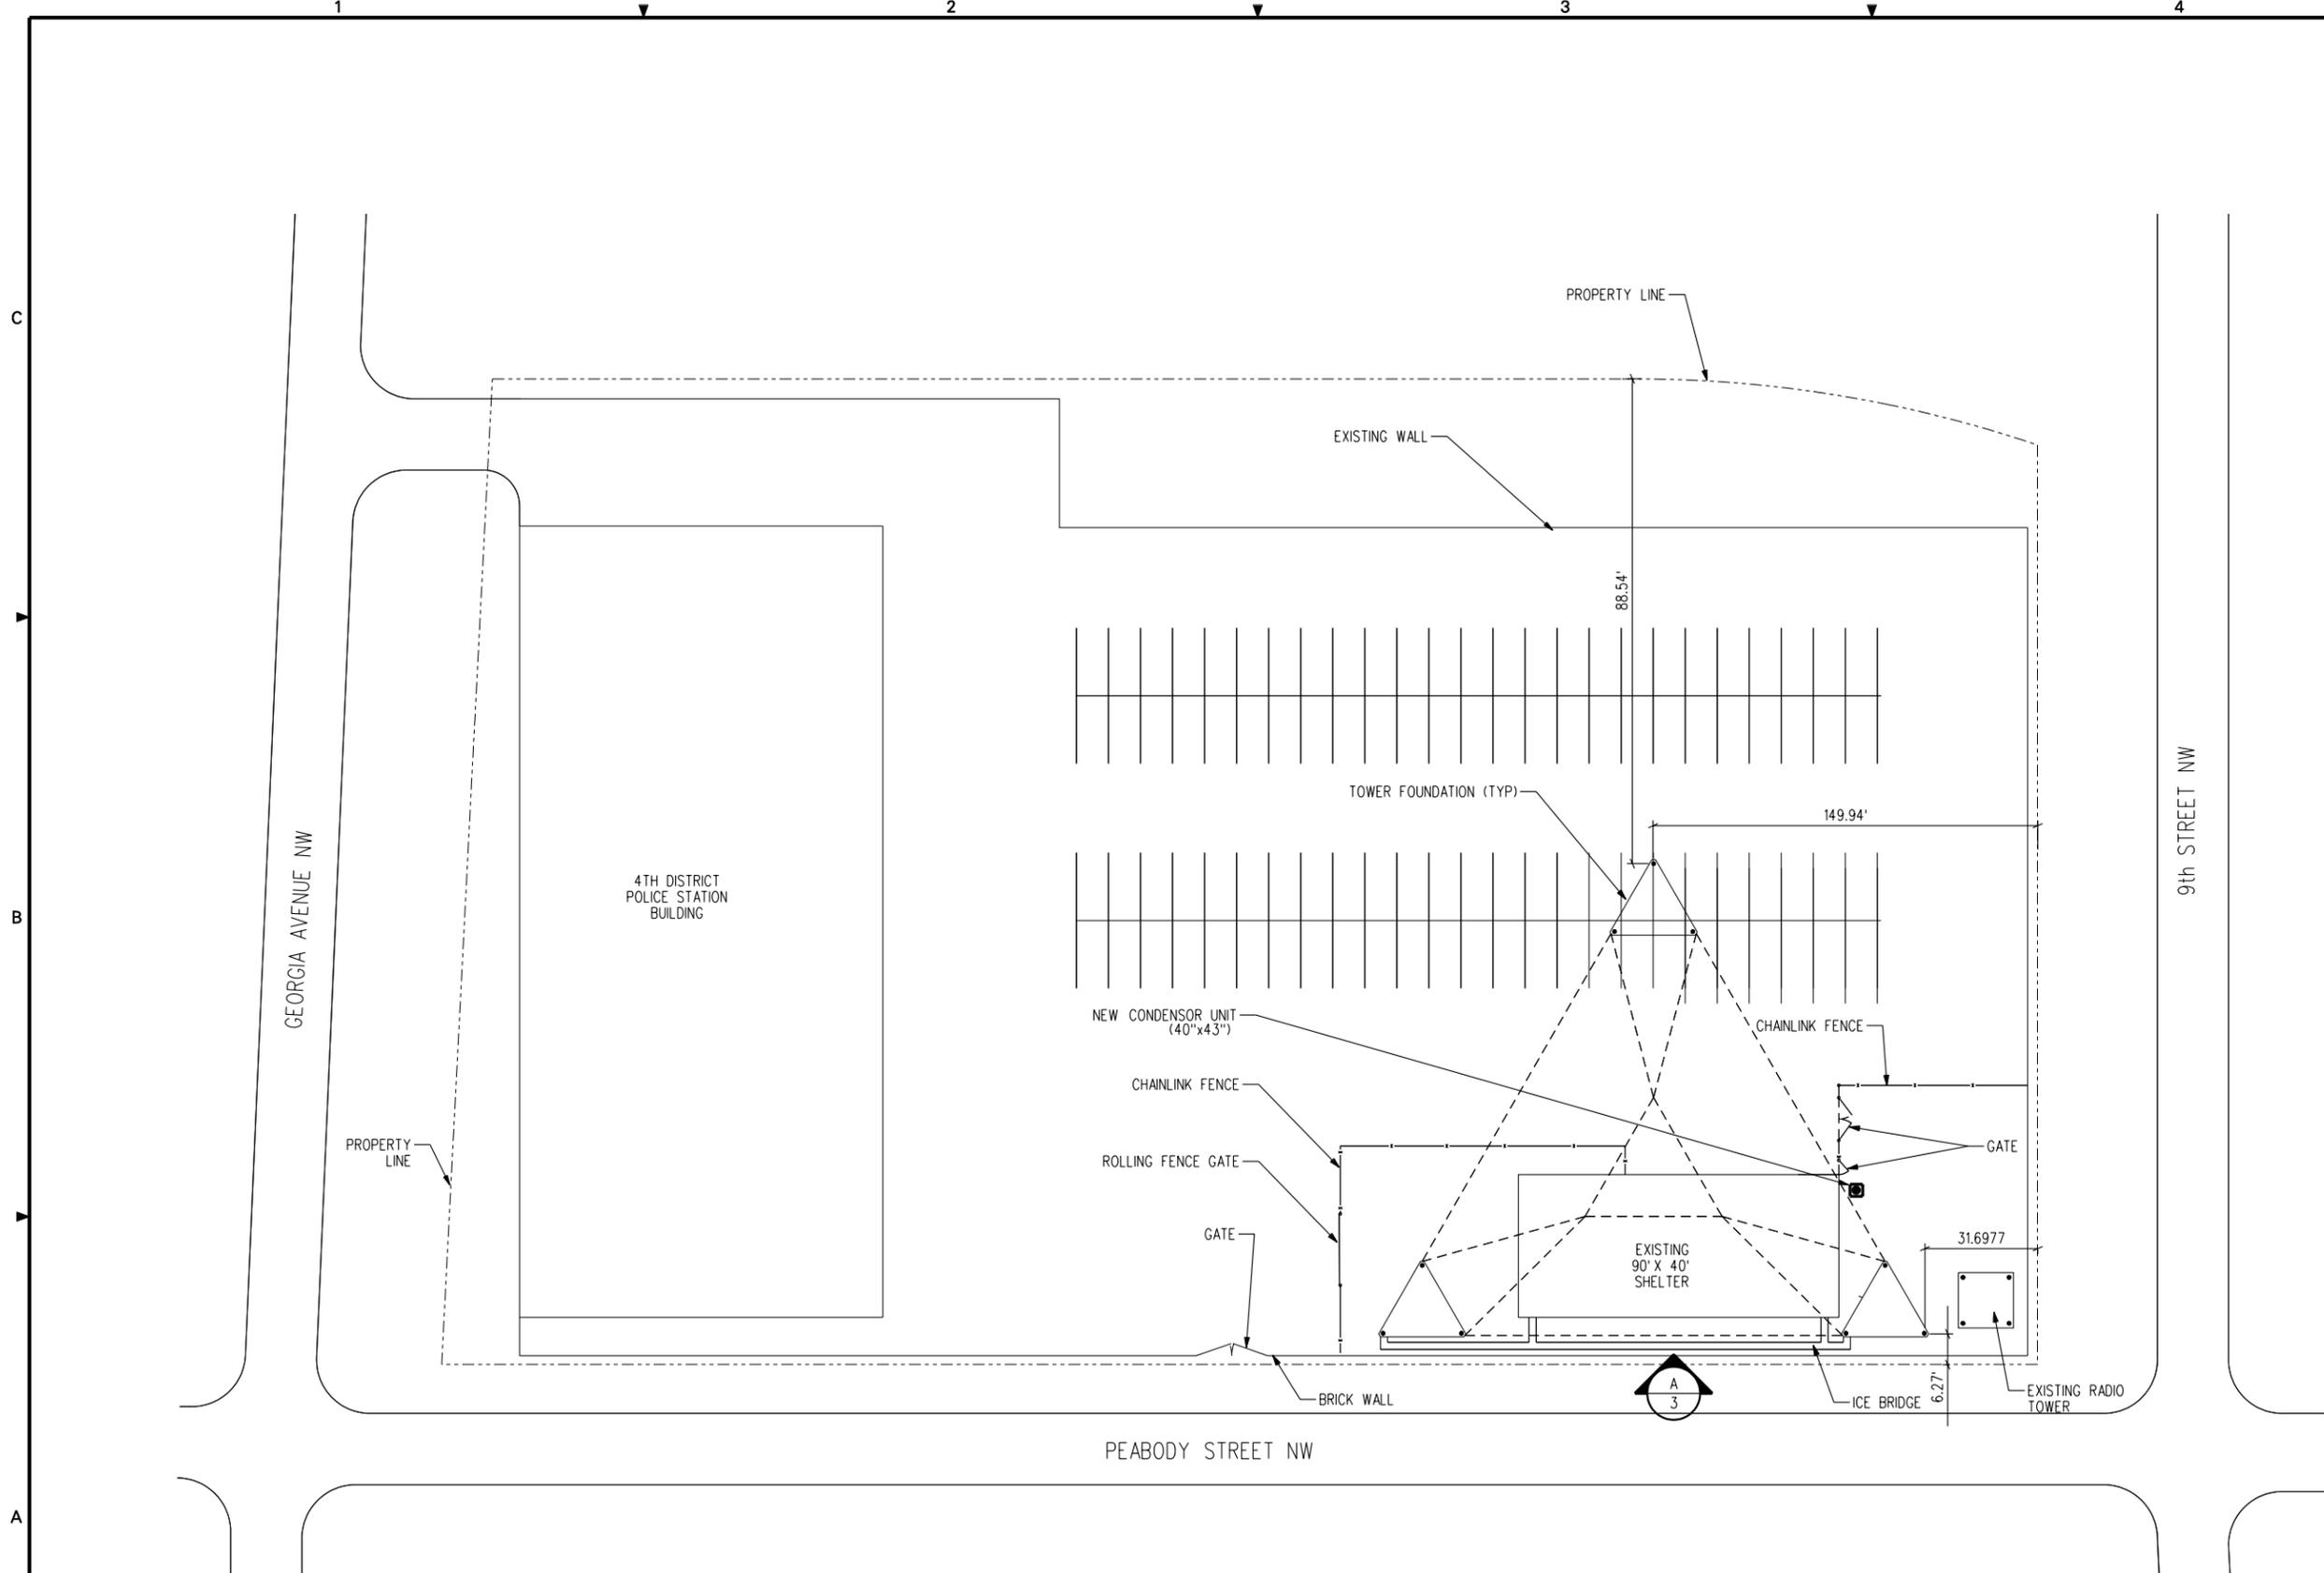

A SITE PLAN
2 SCALE: NTS

NOTE:
SEE SHEET 4 of 4 FOR TOPOGRAPHICAL SURVEY.




Issue:	
Date:	Description:
1/20/03	DRAFT FOR REVIEW
1/23/03	FOR ZONING PERMIT
1/30/03	FOR ZONING PERMIT (FINAL)
2/06/03	FOR ZONING PERMIT (REVISED)

**PUBLIC SAFETY
COMMUNICATIONS
PROJECT**

4D / HUGHES TOWER
6001 GEORGIA AVENUE, NW
WASHINGTON, DC 20011



Key Plan:



Scales:


Drawing Title:
4D / HUGHES TOWER

**ZONING DOCUMENTS
ELEVATION**

Date: 01/23/03

Designed By: DBS
Drawn By: NK
Checked By: NK

Drawing No.:
3 of 4

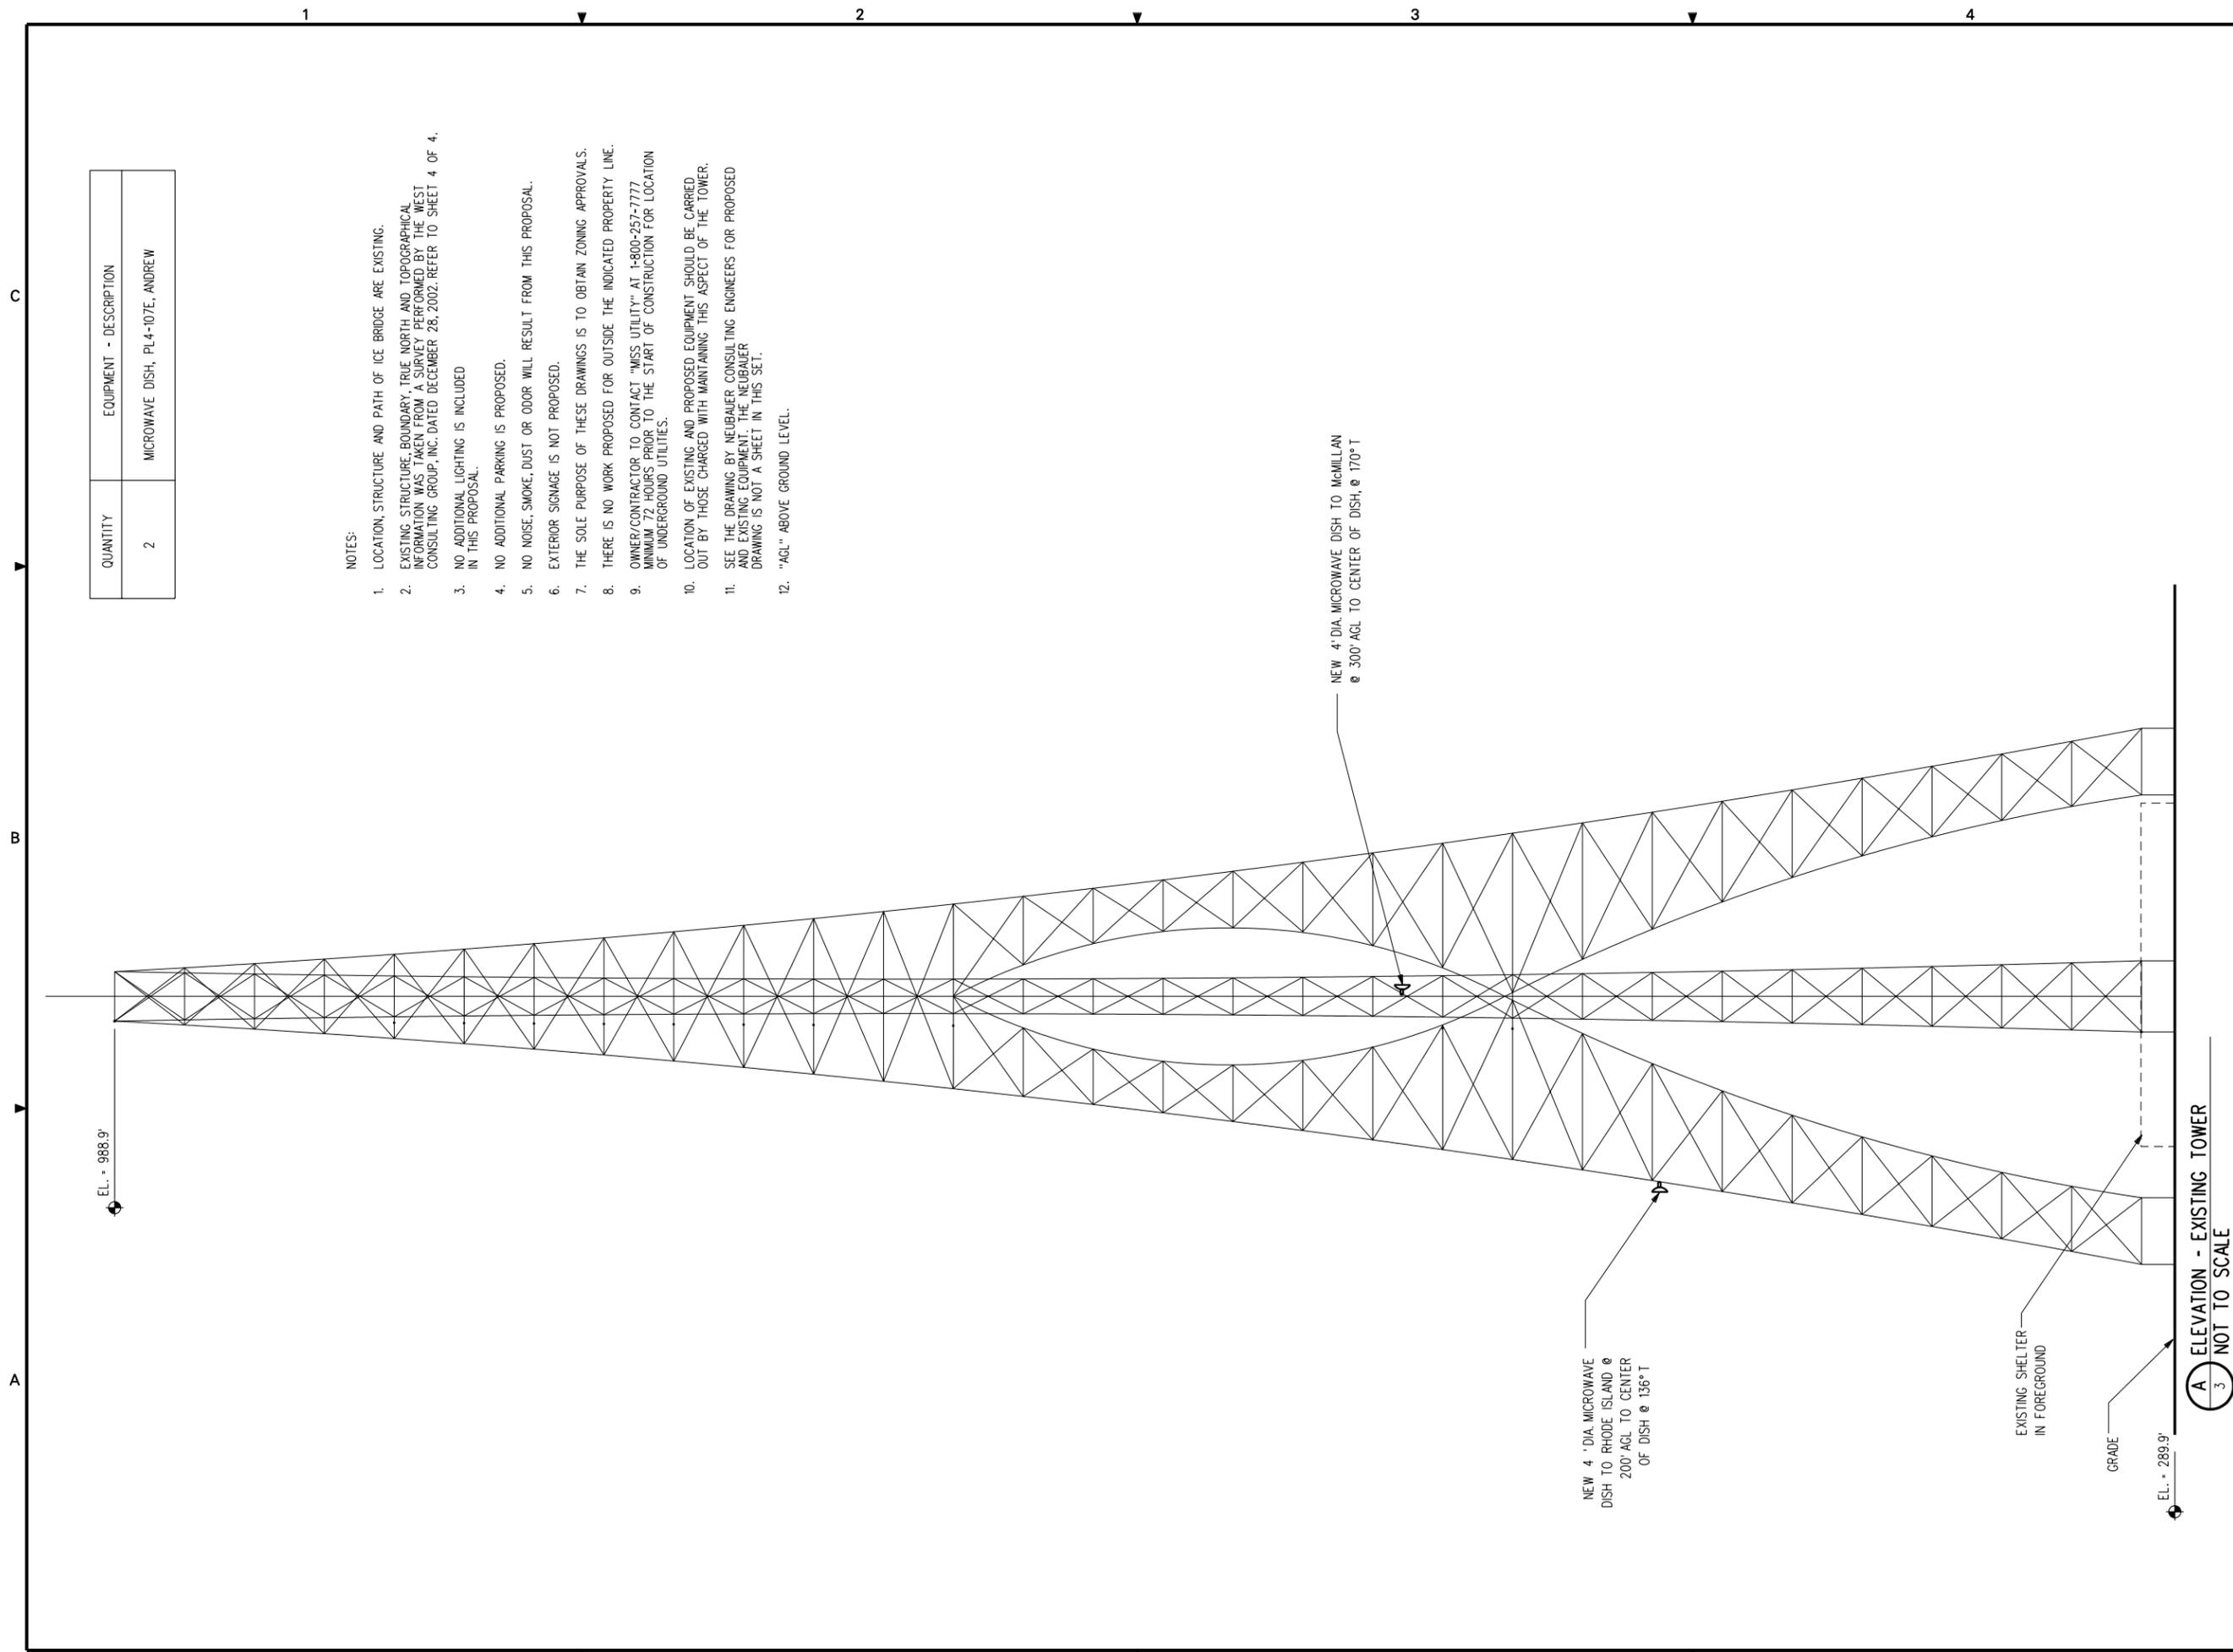

QUANTITY	EQUIPMENT - DESCRIPTION
2	MICROWAVE DISH, PL 4-107E, ANDREW

NOTES:


1. LOCATION, STRUCTURE AND PATH OF ICE BRIDGE ARE EXISTING.
2. EXISTING STRUCTURE BOUNDARY, TRUE NORTH AND TOPOGRAPHICAL INFORMATION WAS TAKEN FROM A SURVEY PERFORMED BY THE WEST CONSULTING GROUP, INC. DATED DECEMBER 28, 2002. REFER TO SHEET 4 OF 4.
3. NO ADDITIONAL LIGHTING IS INCLUDED IN THIS PROPOSAL.
4. NO ADDITIONAL PARKING IS PROPOSED.
5. NO NOISE, SMOKE, DUST OR ODOR WILL RESULT FROM THIS PROPOSAL.
6. EXTERIOR SIGNAGE IS NOT PROPOSED.
7. THE SOLE PURPOSE OF THESE DRAWINGS IS TO OBTAIN ZONING APPROVALS.
8. THERE IS NO WORK PROPOSED FOR OUTSIDE THE INDICATED PROPERTY LINE.
9. OWNER/CONTRACTOR TO CONTACT "MISS UTILITY" AT 1-800-257-7777 MINIMUM 72 HOURS PRIOR TO THE START OF CONSTRUCTION FOR LOCATION OF UNDERGROUND UTILITIES.
10. LOCATION OF EXISTING AND PROPOSED EQUIPMENT SHOULD BE CARRIED OUT BY THOSE CHARGED WITH MAINTAINING THIS ASPECT OF THE TOWER.
11. SEE THE DRAWING BY NEUBAUER CONSULTING ENGINEERS FOR PROPOSED AND EXISTING EQUIPMENT. THE NEUBAUER DRAWING IS NOT A SHEET IN THIS SET.
12. "AGL" ABOVE GROUND LEVEL.

Issue:	Date:	Description:
	1/20/03	DRAFT FOR REVIEW
	1/23/03	FOR ZONING PERMIT
	1/30/03	FOR ZONING PERMIT (FINAL)
	2/06/03	FOR ZONING PERMIT (REVISED)

PUBLIC SAFETY COMMUNICATIONS PROJECT
4D / HUGHES TOWER
6001 GEORGIA AVENUE, NW
WASHINGTON, DC 20011



Key Plan:



Scales:

Drawing Title:
4D / HUGHES TOWER

ZONING DOCUMENTS
TOPOGRAPHICAL SURVEY

Date: 01/23/03


Designed By: -

Drawn By: -

Checked By: NK

Drawing No.:

4 of 4

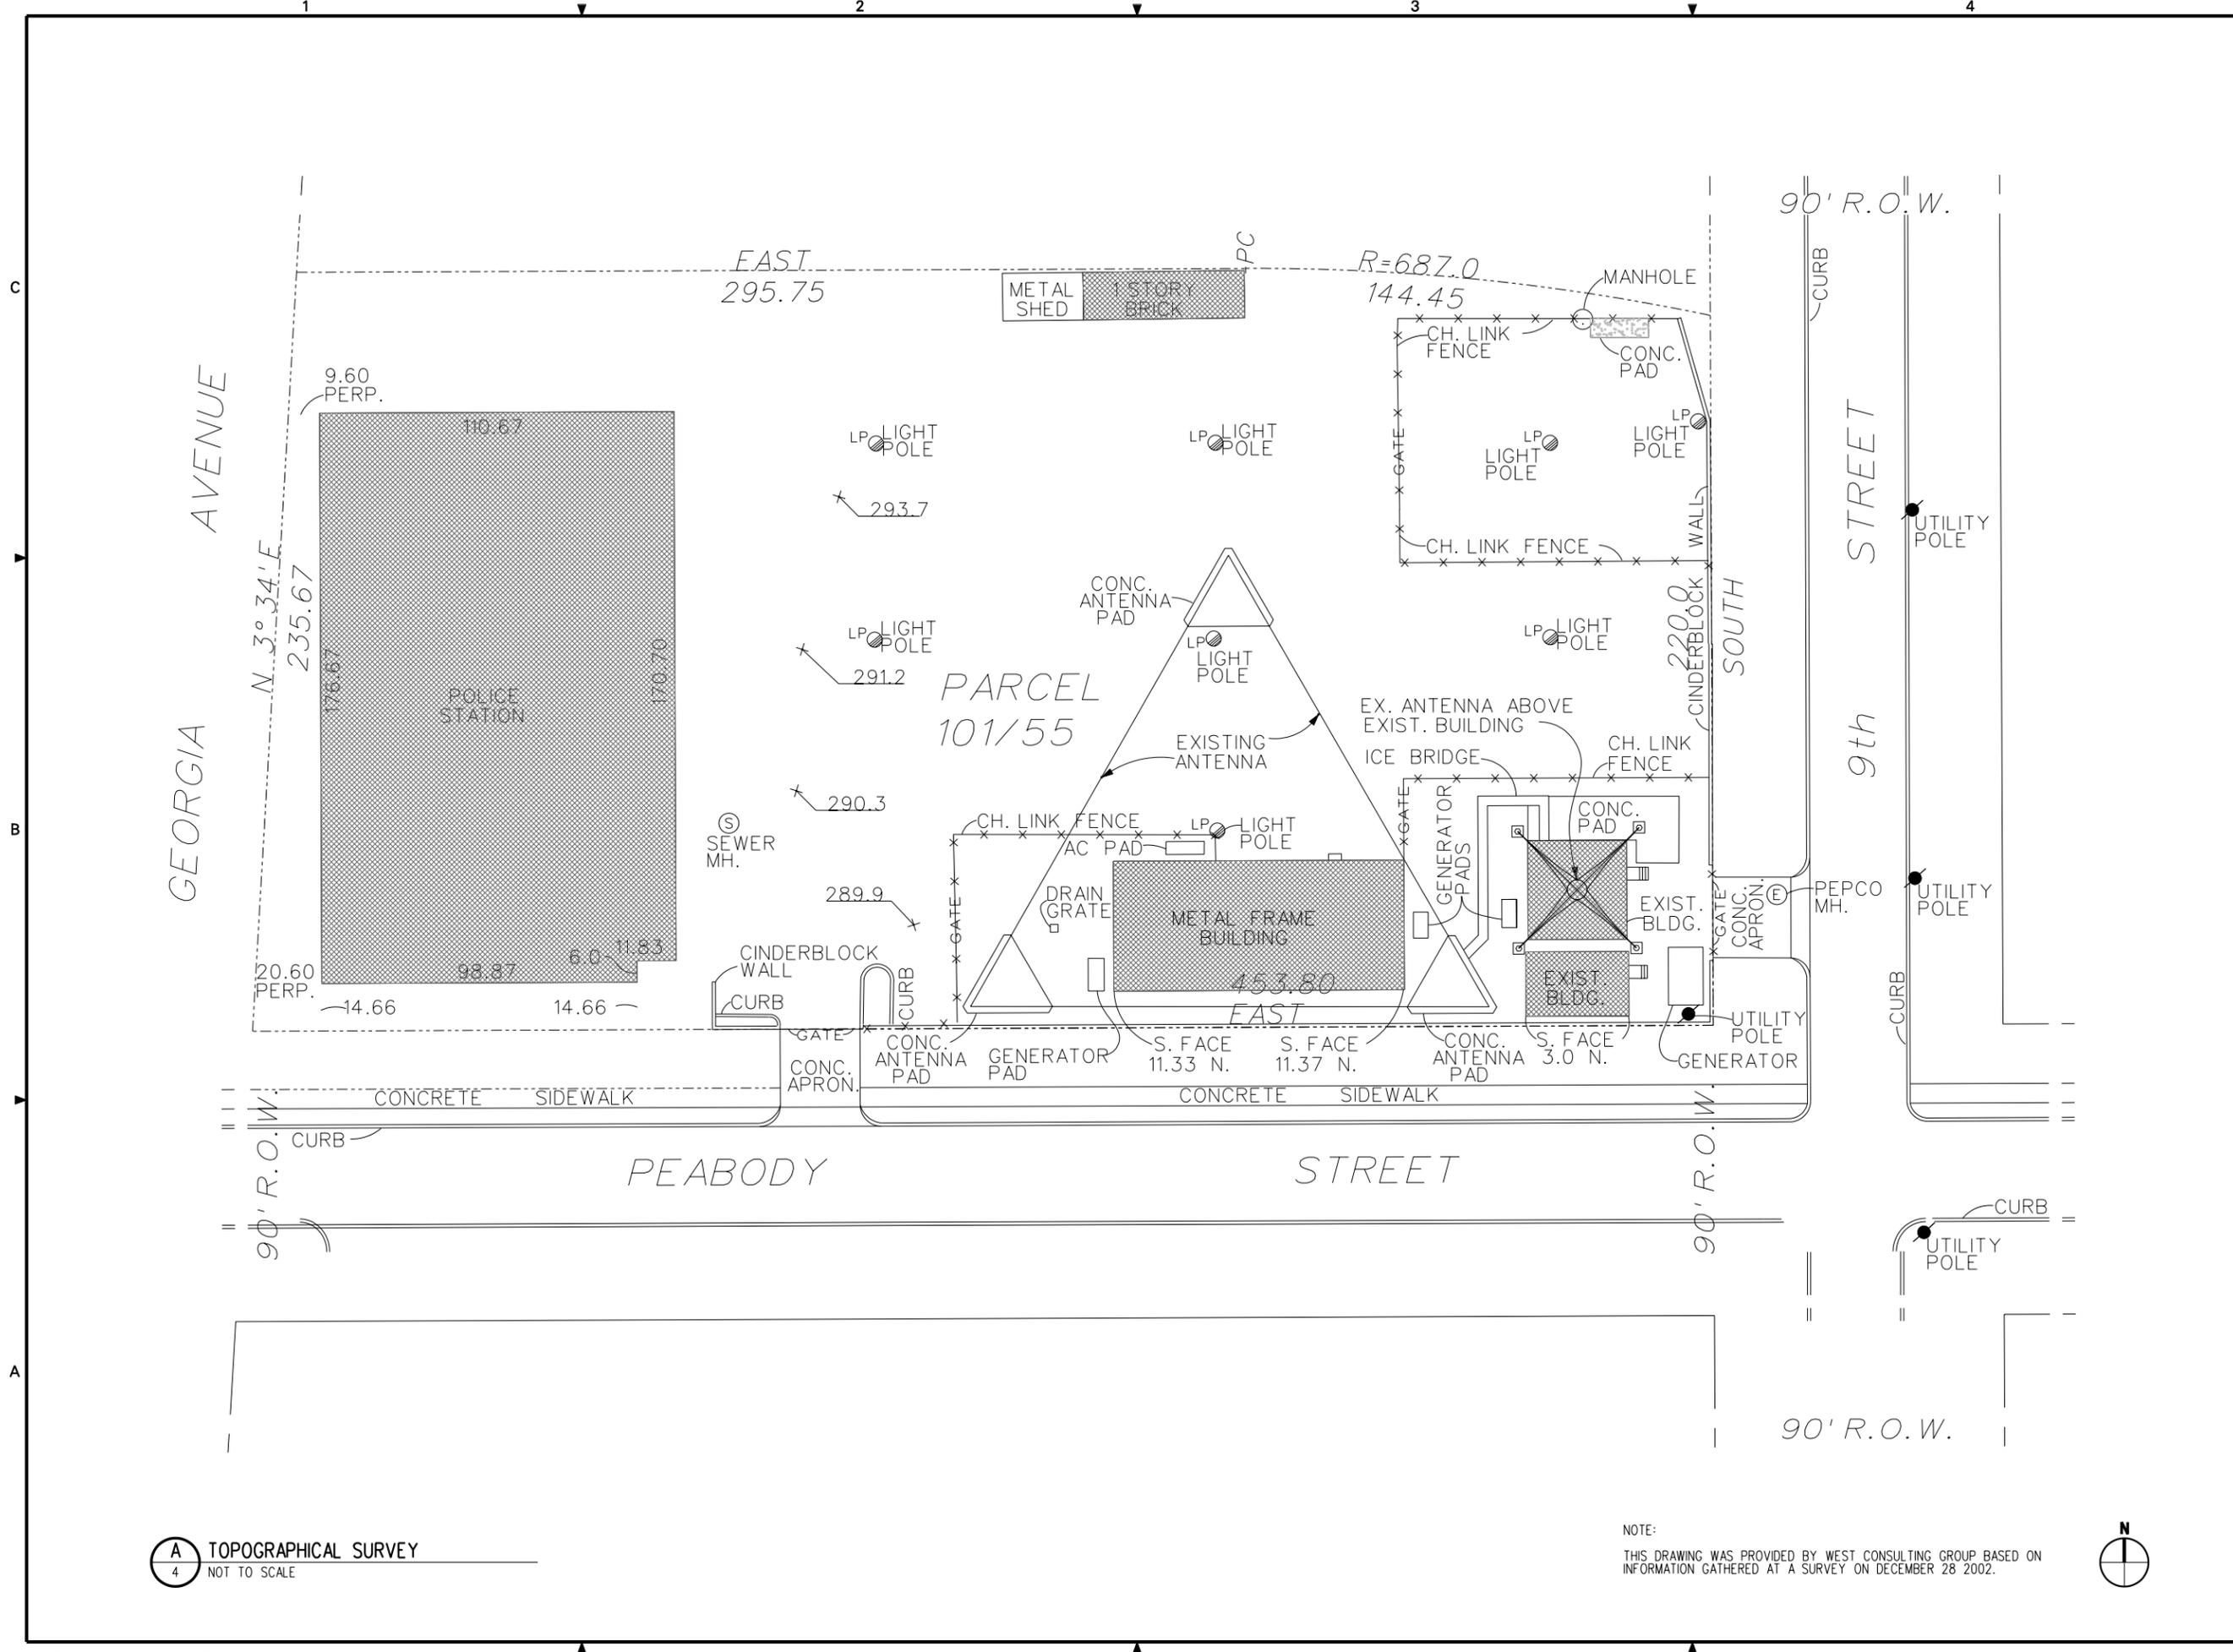

A TOPOGRAPHICAL SURVEY
4 NOT TO SCALE

NOTE:
THIS DRAWING WAS PROVIDED BY WEST CONSULTING GROUP BASED ON INFORMATION GATHERED AT A SURVEY ON DECEMBER 28 2002.