

AMENDMENT OF SOLICITATION/MODIFICATION OF CONTRACT			1. Contract Number DCHA-2010-B-0110	Page of Pages 1 5
2. Amendment/Modification Number DCHA-2010-B-0110-002	3. Effective Date 28-Apr-10	4. Requisition/Purchase Request No.		5. Solicitation Caption See Below
6. Issued By: Department of Real Estate Services Contract and Procurement Division 2000 14th Street N.W., Suite 500 Washington, D.C. 20009		Code 03B	7. Administered By (If other than line 6) Department of Real Estate Services Contract and Procurement Division 2000 14th Street N.W., Suite 500 Washington, D.C. 20009	
8. Name and Address of Contractor (No. Street, city, country, state and ZIP Code)			(X)	9A. Amendment of Solicitation No. DCHA-2010-B-0110
				9B. Dated (See Item 11) 13-Apr-10
				10A. Modification of Contract/Order No.
				10B. Dated (See Item 13)
Code	Facility			
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS				
<input type="checkbox"/> The above numbered solicitation is amended as set forth in Item 14. The hour and date specified for receipt of Offers <input type="checkbox"/> is extended. <input checked="" type="checkbox"/> is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copy of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) By separate letter or fax which includes a reference to the solicitation and amendment number. FAILURE OF YOUR ACKNOWLEDGEMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such change may be made by letter or fax, provided each letter or telegram makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.				
12. Accounting and Appropriation Data (If Required)				
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTS/ORDERS, IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14				
(X)	A. This change order is issued pursuant to: (Specify Authority)			
	The changes set forth in Item 14 are made in the contract/order no. in item 10A.			
	B. The above numbered contract/order is modified to reflect the administrative changes (such as changes in paying office, appropriation data, etc.) set forth in item 14, pursuant to the authority of 27 DCMR, Chapter 36, Section 3601.2.			
	C. This supplemental agreement is entered into pursuant to authority of:			
	D. Other (Specify type of modification and authority)			
E. IMPORTANT: Contractor <input type="checkbox"/> is not, <input checked="" type="checkbox"/> is required to sign this document and return <u>1</u> copy to the issuing office.				
14. Description of amendment/modification (Organized by UCF Section headings, including solicitation/contract subject matter where feasible.)				
The subject solicitation is hereby amended as follows:				
1 Responses to Questions from Prospective Bidders (Attachment A).				
Except as provided herein, all terms and conditions of the document referenced in Item (9A or 10A) remain unchanged and in full force and effect				
15A. Name and Title of Signer (Type or print)			16A. Name of Contracting Officer Diane Wooden	
15B. Name of Contractor		15C. Date Signed	16B. District of Columbia	
			16C. Date Signed 4/28/10	
(Signature of person authorized to sign)			(Signature of Contracting Officer)	

RECONSTRUCTION OF 10TH AND FRENCH STREET PARK, NW
SOLICITATION NO. DCHA-2010-B-0110
QUESTION AND ANSWERS FROM PROSPECTIVE BIDDERS

Q: Trash receptacles: Please provide a manufacturer and model number as various options are available.

A: Trash receptacle shall be DPR standard or equal. See DPR standard detail "Litter Receptacle, 36 Gallon," attached.

Q: Compacted fill: Please provide a drawing/section and detailed specifications for filling the existing depressed area to street level (under grass, planted areas, and unit pavers). Current information on drawing LD-2 and Specification No. 312000-3.6 are not sufficient for pricing and quality control.

A: DPR deems the plans and specifications sufficient for bidding and building. Fill shall be placed per Plans and Specifications dated April 2010. See, e.g., Specification Section 017300 Execution; Specification Section 312000 Earth Moving; Sheets D-1, D-2 and D-3 site drainage plan and details; Sheets L-1, L-2, L-3, L-4 and L-4 site plan and details; LD-2, LD-3 and LD-5 site details.

Q: Pavers: On drawings 1/LD-2 & 7/LD-2 the vertical cobblestone edge should be set on a mortar bed for stability. Please provide modified detail.

A: Detail shall be built as designed and specified per Plans and Specifications dated April 2010. See, e.g., Specification Section 017300 Execution; Specification Section 312000 Earth Moving; Specification Section 321400 Unit Paving; Sheets L-1, L-2, L-3, L-4 and L-4 site plan and details.

Q: Pavers: On drawing 8/LD-2 the CMU planter wall should be waterproofed on the planter side. Please provide modified detail.

A: Detail shall be built as designed and specified per Plans and Specifications dated April 2010. See, e.g., Specification Section 017300 Execution, Specification Section 312000 Earth Moving; Specification Section 042113 Brick Masonry; Sheets LD-2 and LD-3 site details.

Q: Pavers: On drawing 8/LD-2 please verify whether the specified 3/8" joint should be mortar or caulk to prevent cracking. Please provide modified detail.

A: See detail 8/LD-2, which calls out "mortar."

Q: Fences and gates: Drawings sheets LD-4 and LD-5 show steel pickets running in front of 3/8" x 2" upper cross bars. Please confirm design intent.

A: See, e.g., DPR standard detail "Fence, Ornamental Steel", attached. See also, e.g., Specification 323119 Decorative Fences and Gates.

Q: Confirm overall fence length to be fabricated with laser cut horizontal steel plates at base.

A: See site plan at Sheet L-1. Contractor is responsible for verifying all dimensions.

Q: On drawing 1/LD-6 clarify whether top bar of wood fence should align with top or bottom of steel fence crossbars w/ circles.


A: Top of wood fence shall align with top of pickets of steel fence. Bottom of wood fence shall align with bottom rail of steel fence.

Q: Planting: Per Specification No. 017300-3.5, provide quantities of plants, soil, mulch, tools, etc. required for community planting events.

A: Plants, soil and mulch for Community Planting Days shall be plants, soil and mulch per plans and specifications, see, e.g., Sheets L-3 and LD-1, and Specifications 329200 and 329300. Contractor is responsible for verifying quantities. Per Specification 017300, item 3.5, line 5, Contractor shall provide tools sufficient to support thirty (30) community members.

Q: Please specify planting locations of bulb types "CC, ND, and SB" listed in planting schedule as they are not identified on the planting plan L-3.

A: All bulbs shall be planted randomly throughout the three "planting areas," see, e.g., Sheet L-1.

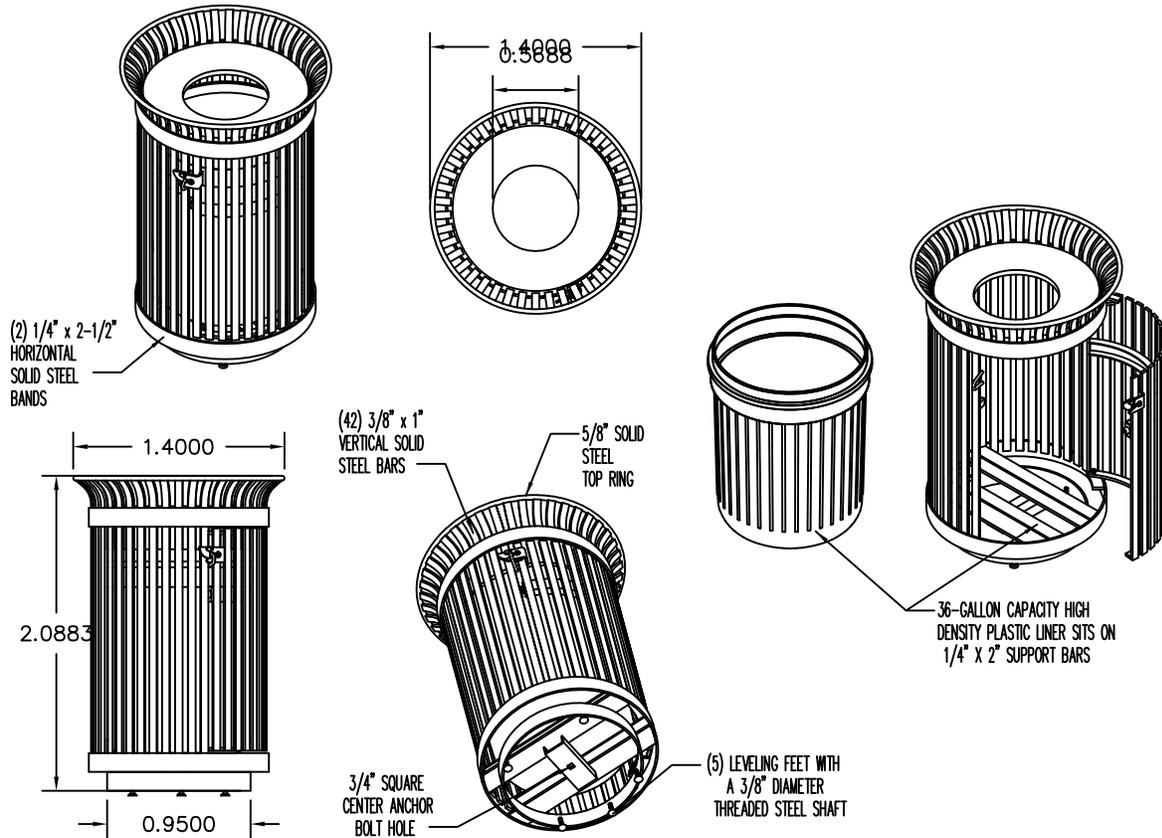

AVAILABLE OPTIONS:

- POWDER COATING
 10 STANDARD COLORS, CUSTOM COLORS (INCLUDING THE RAL RANGE)
- CUSTOM PLAQUES & DECALS
 AVAILABLE WITH STEEL PLAQUES IN VARIOUS SIZES AND PRESSURE SENSITIVE VINYL OUTDOOR DECALS.

LIDS


SHOWN WITH STANDARD TAPERED FORMED RIVETED LID. AVAILABLE WITH OPTIONAL S-2ASD FORMED DOME, S-2ASD FORMED DOME WITH STAINLESS STEEL ASHTRAY, AND DS-32 FORMED DOME W/ SELF CLOSING DOOR

SECURITY

SHOWN WITH STANDARD LOCKABLE LATCH AVAILABLE WITH OPTIONAL KEYED LOCK BOX. LID RIVETED IN PLACE.

NOTES:

1. DRAWINGS NOT TO SCALE. DO NOT SCALE DRAWINGS.
2. ALL FABRICATED METAL COMPONENTS ARE STEEL SHOTBLASTED, ETCHED, PHOSPHATIZED, PREHEATED, AND ELECTROSTATICALLY POWDER-COATED WITH T.G.I.C. POLYESTER POWDER COATINGS. PRODUCTS ARE FULLY CLEANED AND PRETREATED, PREHEATED AND COATED WHILE HOT TO FILL CREVICES AND BUILD FILM COATING. COATED PARTS ARE THEN FULLY CURED TO COATING MANUFACTURER'S SPECIFICATIONS. THE THICKNESS OF THE RESULTING FINISH COAT AVERAGES 8-10 MILS (200-250 MICRONS).
3. OLITE BRONZE BEARINGS AND STAINLESS STEEL PIVOT PINS FOR DOOR MOVEMENT, STANDARD 1/4" SOLID STEEL LATCH ASSEMBLY OR OPTIONAL PATENTED STAINLESS STEEL KEYED LOCK ASSEMBLY.
4. THIS VICTOR STANLEY, INC. PRODUCT MUST BE PERMANENTLY AFFIXED TO THE GROUND. CONSULT YOUR LOCAL CODES FOR REGULATIONS.
5. ANCHOR BOLTS PROVIDED BY OTHERS.
6. FOR HIGH SALT ABUSIVE CLIMATES, HOT DIP GALVANIZING BEFORE POWDER COATING IS AVAILABLE. SEE WRITTEN SPECIFICATIONS FOR DETAILS.
7. THIS PRODUCT IS SHIPPED FULLY ASSEMBLED


 **SD-42 SDDC-42 (STANDARD MODEL WITH "RAT PLATE")**

IRONSITES SERIES 36-GALLON SIDE-DOOR-OPENING LITTER RECEPTACLE
 SHOWN: STANDARD TAPERED FORMED RIVETED LID

COPYRIGHT 2003 VICTOR STANLEY, INC. ALL RIGHTS RESERVED
 REV. 8/7/03 DRAWN C.D.B.

NOTES: COLOR: BLACK

DATE 10/05/09	NO. NORTH NA	TITLE LITTER RECEPTACLE, 36 GALLON	DISTRICT OF COLUMBIA DEPARTMENT OF PARKS AND RECREATION Office of Planning & Capital Projects Main Office: 3149 16th Street, N.W. Washington, D.C. 20010 202-673-7647 www.dpr.dc.gov	
SCALE NO SCALE	TYPE DETAIL			

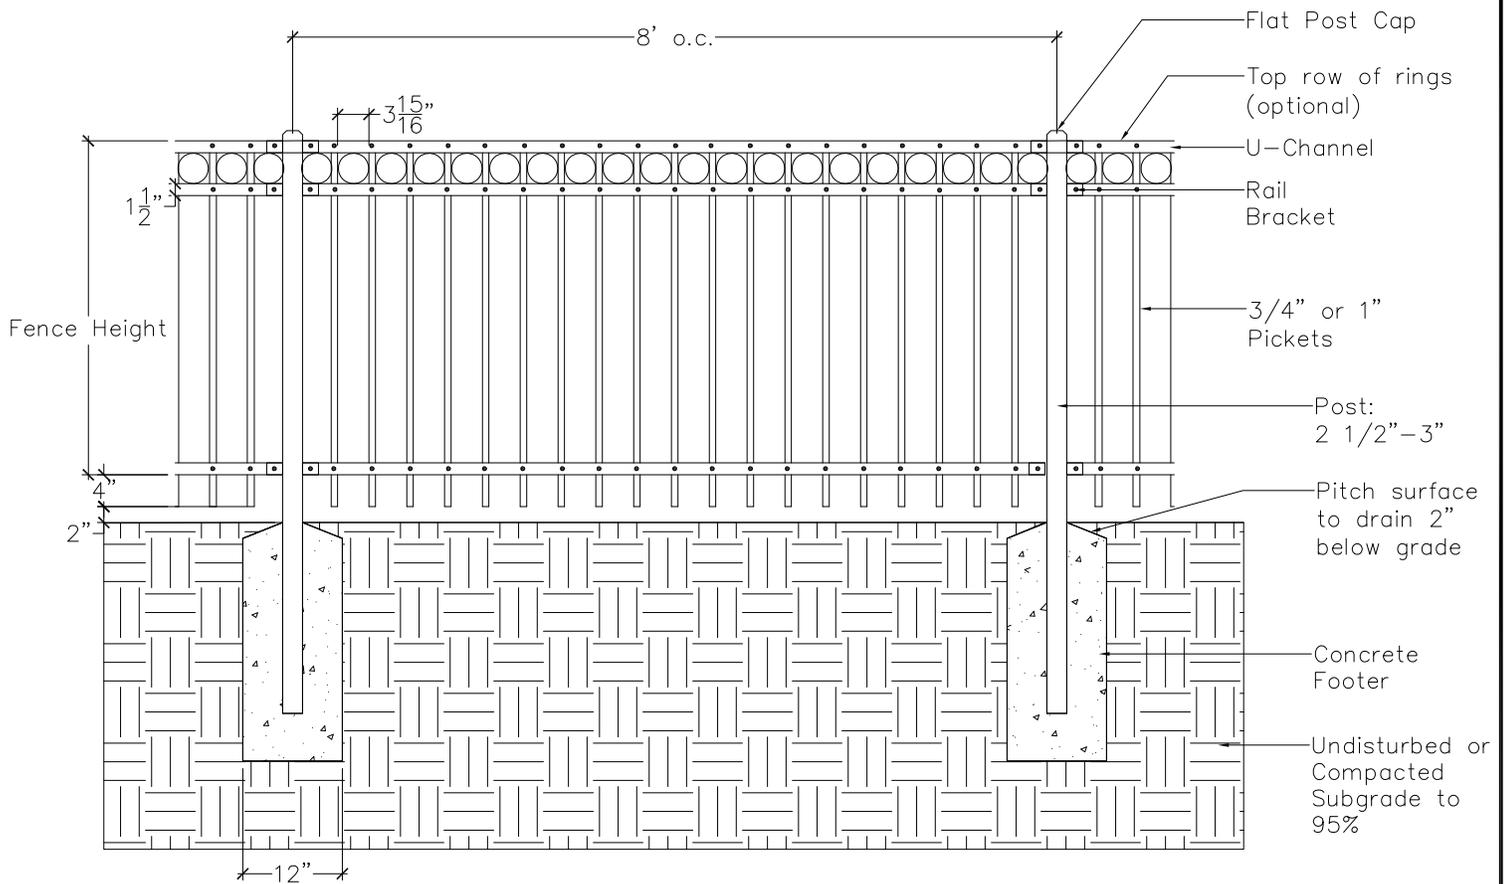

NOTES

- 1) Verify the exact location and elevation of all underground utilities and other structures before starting work. Call Miss Utility: 1-800-257-7777
- 2) Use extreme care to protect roots of existing trees. Do not stockpile rubble or other debris at the base of trees. Tree protection is to be used to prevent damage during site work.
- 3) Use extreme care to protect all existing elements to remain from damage or displacement. Remove any debris or trash unearthed during excavation and dispose of legally.
- 4) Consult drawing for fence location(s) and fence height(s). Layout and staking of tubular steel fence is to be done in the field by the contractor and approved by the COTR prior to the start of construction.
- 5) Drill or hand excavate holes in firm, undisturbed or compacted soil to local frost depth. Holes shall be no less than 10" in diameter and 42" deep. Set posts 6" above existing grade.
- 6) Set fence posts in holes nominal 8'-0" on center. Set gate posts for gate opening as specified on the drawing. If fence is to be placed along a slope, the contractor shall contact the COTR regarding how to proceed.
- 7) Fill hole with concrete. Take care to slope concrete away from support posts for drainage purposes. Finished concrete shall be two (2) inches below existing grade.
- 8) Repeat steps 5-7 for each section of fencing. Verify that fencing is set plumb, aligned, and at correct height and spacing as specified on drawing. Hold in position during placement and finishing operations until concrete is sufficiently cured.
- 9) All tubular steel fencing shall have standard flat post caps unless otherwise specified.

DATE 10/05/09 SCALE 1/2" = 1' 	NORTH NA	TITLE <p style="text-align: center;">FENCE, ORNAMENTAL STEEL</p>	<p style="text-align: center;">DISTRICT OF COLUMBIA DEPARTMENT OF PARKS AND RECREATION</p> <p>Office of Planning & Capital Projects Main Office: 3149 16th Street, N.W. Washington, D.C. 20010 202-673-7647 www.dpr.dc.gov</p>	
TYPE DETAIL				