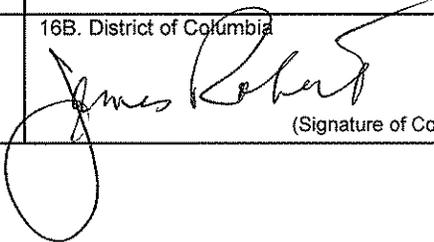


AMENDMENT OF SOLICITATION / MODIFICATION OF CONTRACT			1. Contract Number	Page of Pages 1 2	
2. Amendment/Modification Number DCKT-2011-B-0156-002	3. Effective Date See 16C Below	4. Requisition/Purchase Request No.	5. Solicitation Caption Installation of Storm Water Management System		
6. Issued by: Office of Contracting and Procurement Transportation and Specialty Equipment Commodity Group 2000 14 th Street, NW, 6 th Floor Washington, DC 20009		Code	7. Administered by (If other than line 6) Department of Public Works Office of Administrative Services 2000 14 th Street, NW, 6 th Floor Washington, DC 20009		
8. Name and Address of Contractor (No. street, city, county, state and zip code)		Code	Facility	9A. Amendment of Solicitation DCKT-2011-B-0156	
				<input checked="" type="checkbox"/>	9B. Dated (See Item 11) 9/14/11
					10A. Modification of Contract Order No.
					10B. Dated (See Item 13)
11. THIS ITEM ONLY APPLIES TO AMENDMENTS OF SOLICITATIONS					
<input type="checkbox"/> The above numbered solicitation is amended as set forth in item 14. The hour and date specified for receipt of Offers <input checked="" type="checkbox"/> is extended. <input type="checkbox"/> is not extended. Offers must acknowledge receipt of this amendment prior to the hour and date specified in the solicitation or as amended, by one of the following methods: (a) By completing Items 8 and 15, and returning <u>1</u> copies of the amendment; (b) By acknowledging receipt of this amendment on each copy of the offer submitted; or (c) BY separate letter or fax which includes a reference to the solicitation and amendment number. FAILURE OF YOUR ACKNOWLEDGMENT TO BE RECEIVED AT THE PLACE DESIGNATED FOR THE RECEIPT OF OFFERS PRIOR TO THE HOUR AND DATE SPECIFIED MAY RESULT IN REJECTION OF YOUR OFFER. If by virtue of this amendment you desire to change an offer already submitted, such may be made by letter or fax, provided each letter or telegram makes reference to the solicitation and this amendment, and is received prior to the opening hour and date specified.					
12. Accounting and Appropriation Data (If Required)					
13. THIS ITEM APPLIES ONLY TO MODIFICATIONS OF CONTRACTORS/ORDERS, IT MODIFIES THE CONTRACT/ORDER NO. AS DESCRIBED IN ITEM 14					
A. This change order is issued pursuant to (Specify Authority): The changes set forth in Item 14 are made in the contract/order no. in item 10A.					
B. The above numbered contract/order is modified to reflect the administrative changes (such as changes in paying office, appropriation data etc.) set forth in item 14, pursuant to the authority of 27 DCMR, Chapter 36, Section 3601.2.					
C. This supplemental agreement is entered into pursuant to authority of:					
D. Other (Specify type of modification and authority)					
E. IMPORTANT: Contractor <input type="checkbox"/> is not <input type="checkbox"/> is required to sign this document and return <u>1</u> copies to the issuing office.					
14. Description of Amendment/Modification (Organized by UCF Section headings, including solicitation/contract subject matter where feasible.) DCKT-2011-B-0156 is amended to provide responses to bidders questions. See page 2 of this amendment. The bid opening date is extended to Monday, October 24, 2011 at 2:00 pm.					
Except as provided herein, all terms and conditions of the document referenced in item (9A or 10A) remain unchanged and in full force and effect.					
15A. Name and Title of Signer (Type or print)		16A. Name of Contracting Officer James Roberts			
15B. Name of Contractor (Signature)	15C. Date Signed	16B. District of Columbia  (Signature of Contracting Officer)	16C. Date Signed 10/13/2011		

AMENDMENT OF SOLICITATION / MODIFICATION OF CONTRACT			1. Contract Number	Page of Pages	
2. Amendment/Modification Number			3. Effective Date	4. Requisition/Purchase Request No.	5. Solicitation Caption
DCKT-2011-B-0156-002			See 16C Below		Installation of Storm Water Management System

Responses to Bidders Questions:

Q1. Is testing and inspection part of the scope of work? Please clarify.

A1. Follow Quality Assurance Paragraphs in Specifications J-1 as well as DCRA permit requirements.

Q2. Section G.17.4 of the solicitation states, "The watchpersons shall be employed and on site during all periods in which the Contractor's employees are not performing actual site work." Please confirm if this is correct.

A2. Delete the requirement G.17.4 for a watchperson at the site. However, the District shall not be responsible for any theft, loss and vandalism of the contractors' equipment or materials he places on site. It is up to the contractors to protect their equipment, tools and materials at the site in any way they see fit.

Q3. Section H.12.1.3 of the solicitation notes, "A prime contractor which is certified as a small, local or disadvantaged business enterprise shall not be required to comply with the provisions of sections H.12.1.1 and H.12.1.2." If a prime contractor is certified as a small business enterprise, do we need to submit the subcontracting plan per section K.9 of the solicitation? Please advise.

A3. Yes. All prime contractors shall submit a subcontracting plan in accordance with Section k-9.

Q4. The bid document does not have any division 1 – general conditions. Please provide Division 1, General Conditions.

A4. Division 1, General Conditions are available for pick up at the Office of Contracting and Procurement, Bid Room located at 2000 14th Street, NW, 3rd Floor, Washington, DC 20009.

Q5. Attachment J.1.7, note #8 "The contractor shall use the existing water, sewer and electric lines supplying the existing Guard Booth as sources for these utilities." Drawings don't show any existing water, sewer and electric lines supplying the existing guard booth. Please provide existing and new utility connection and profile details for water, sewer and electric lines.

A5. The contractor shall survey the existing guard booth and determine the bid price for providing these utilities for the guard booth. The bid price for the provision of these services shall be incorporated into the total lump sum bid price of the project. No drawings are available.

Q6. Specification section 321216 – Asphalt Paving, paragraph 3.5.C calls for prime coat and drawing C-3.13 doesn't show any prime coat on typical asphalt parking lot pavement section and typical asphalt roadway pavement section. Do we need to provide prime coat for asphalt work?

A6. Prime Coat shall be applied in accordance with the specifications wherever it is applicable.

Q7. Can we substitute PG-64-22 in lieu of PG-70-62 for the asphalt binder?

A7. Yes

Q8. Please confirm that standard traffic paint is required and not the thermoplastic one?

A8. Standard traffic paint is required.

Q9. Are the traffic arrows shown on drawings C-3.00 and C-3.01 to be painted or are they shown for informational purpose only?

A9. These are traffic arrows to be painted on the pavement.

Q10. Please provide the following missing specification sections and drawing details:

- a. Sanitary sewer line for guard booth
- b. Water line for guard booth and fountain

A10. For answer, see Question No.5 above.

Q11. Drawing E1.00 refers to lighting panel L. Where is this lighting panel L located? What is the amperage of this panel L?

A11. Lighting Panel "L" is located outdoor by the electric meter. The contractor shall visit the site and take note of the amperage of the Panel "L".

Q12. Attachment J.1.7 of the general note #3 requests to delete the security control of the front gate. Are the gates being deleted as well? If not, please provide the specification section and details for the gates.

A12. The response to this question will be provided in a subsequent amendment.

Q13. Drawing E1.00 shows one note #24 referring to a light pole. Note #24 indicates some of the existing wireless equipment to be removed/relocated accordantly with the existing light poles and make necessary connections for proper functions. None of these wireless equipment are shown on the bid document. How many of these wireless equipment are we to relocate? Please clarify.

A13. There are 8 wireless antennas to be removed from eight poles and the same will be installed back on the new poles once the job is completed or as directed by the COTR.